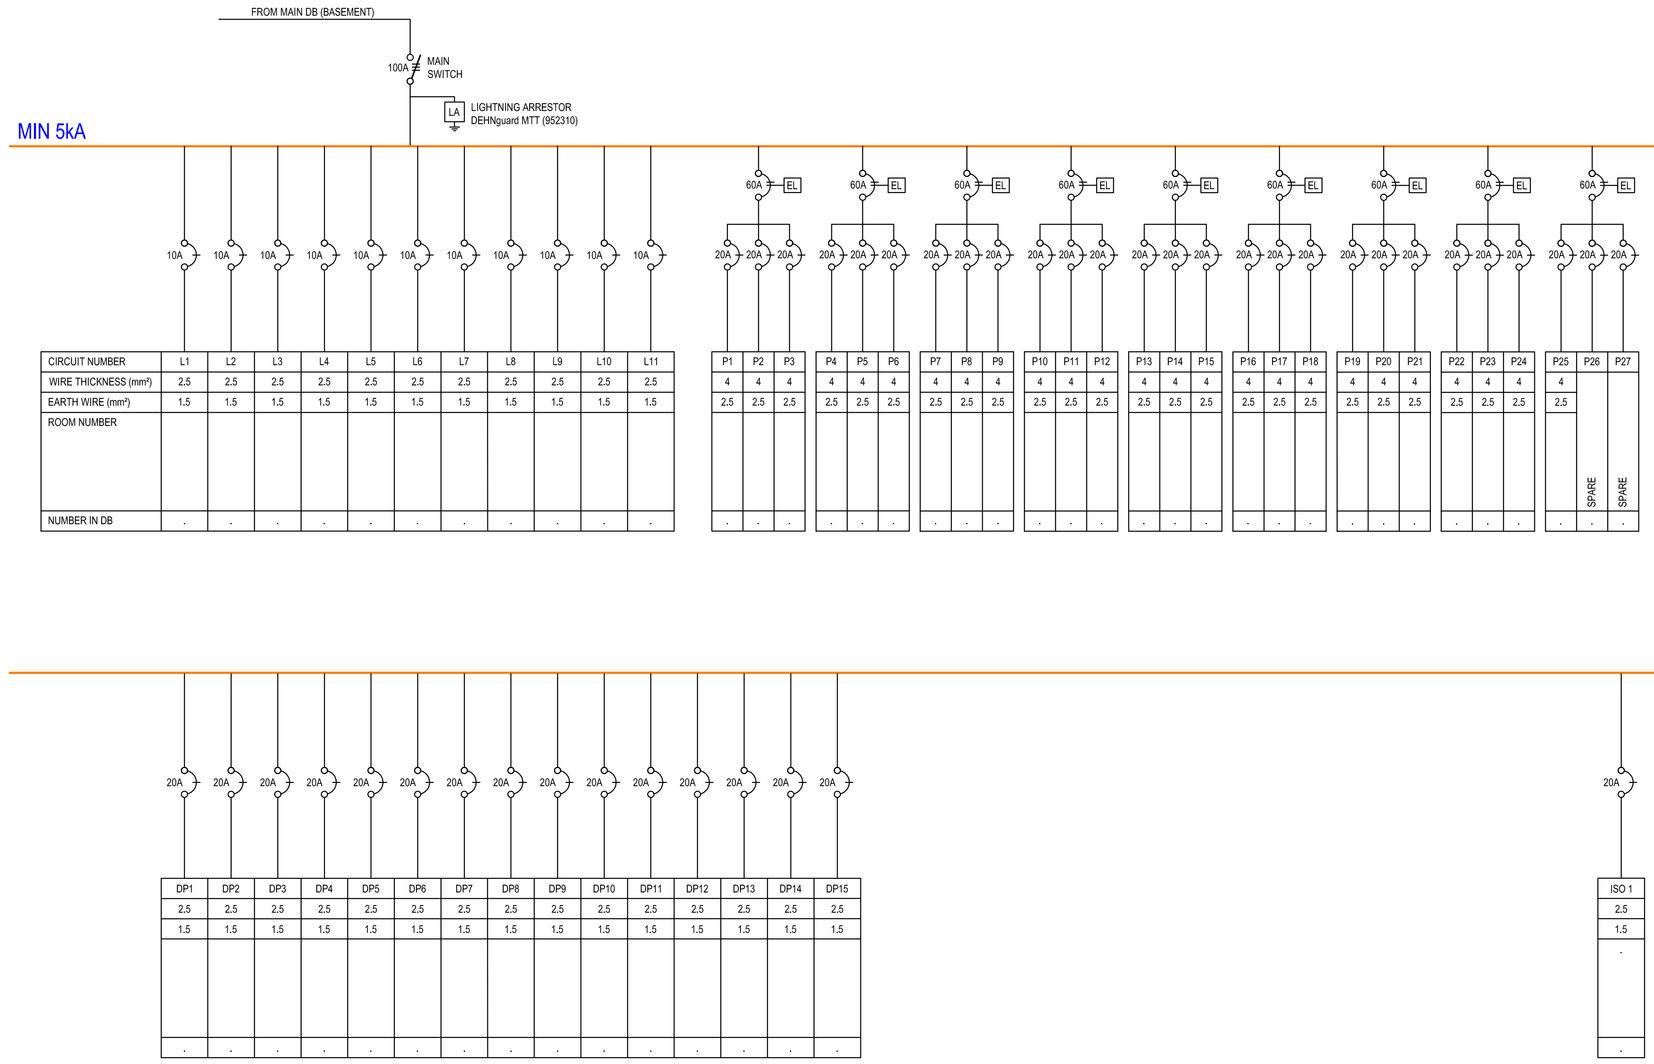

CIRCUIT NUMBER	L1	L2	L3	L4	L5	L6	L7	L8	L9	L10	L11
WIRE THICKNESS (mm²)	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5
EARTH WIRE (mm²)	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5
ROOM NUMBER											
NUMBER IN DB	-	-	-	-	-	-	-	-	-	-	-

P1	P2	P3	P4	P5	P6	P7	P8	P9	P10	P11	P12	P13	P14	P15	P16	P17	P18	P19	P20	P21	P22	P23	P24	P25	P26	P27
4	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4		
2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5		
-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	SPARE	SPARE
-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

CL
4
2.5
-
PARAPLEGIC CHAIR LIFT
-

DP1	DP2	DP3	DP4	DP5	DP6	DP7	DP8	DP9	DP10	DP11	DP12	DP13	DP14	DP15
2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5
1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5
-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

ISO 1
2.5
1.5
-
-

A/C 1	A/C 2	A/C 3	A/C 4	A/C 5	A/C 6	A/C 7	A/C 8	A/C 9	A/C 10	A/C 11	A/C 12	A/C 13	A/C 14	A/C 15	A/C 16	A/C 17	A/C 18	A/C 19
2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5
1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5
-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

WITH 30% SPARE SPACE

VARIATIONS / WYSIGINGS

DATE DATUM	No Nr	VARIATION WYSIGING
AUG 2015	A	UPDATED TO SARS REQUIREMENTS

CLIENT: KLIENT:

SARS South African Revenue Service

PROJECT: PROJEK:

BLOEMFONTEIN CENTRAL GOVERNMENT BUILDING REFURBISHMENT PROJECT

DRW DESCRIPTION: TEKENINGBESKRWYING:

ELECTRICAL INSTALLATION

GROUND FLOOR
DB-GN
SINGLE LINE DIAGRAM

DESIGN: ONTWERP:	O. MOFFAT	DATE:
DRAWN: GETEKEN:	A DU PLOOY	DATE:
CHECKED: NAGESIEN:		DATE:
APPROVED: GOEDGEKEUR:		DATE:
CLIENT APPROVAL: KLIENT GOEDKEURING:		DATE:

SCALE:	DATE:
NOT TO SCALE	AUGUST 2015

DRAWING No:	REVISION:
B03.BFN.000098/E/010	A

DEPT. DRAWING No:

..