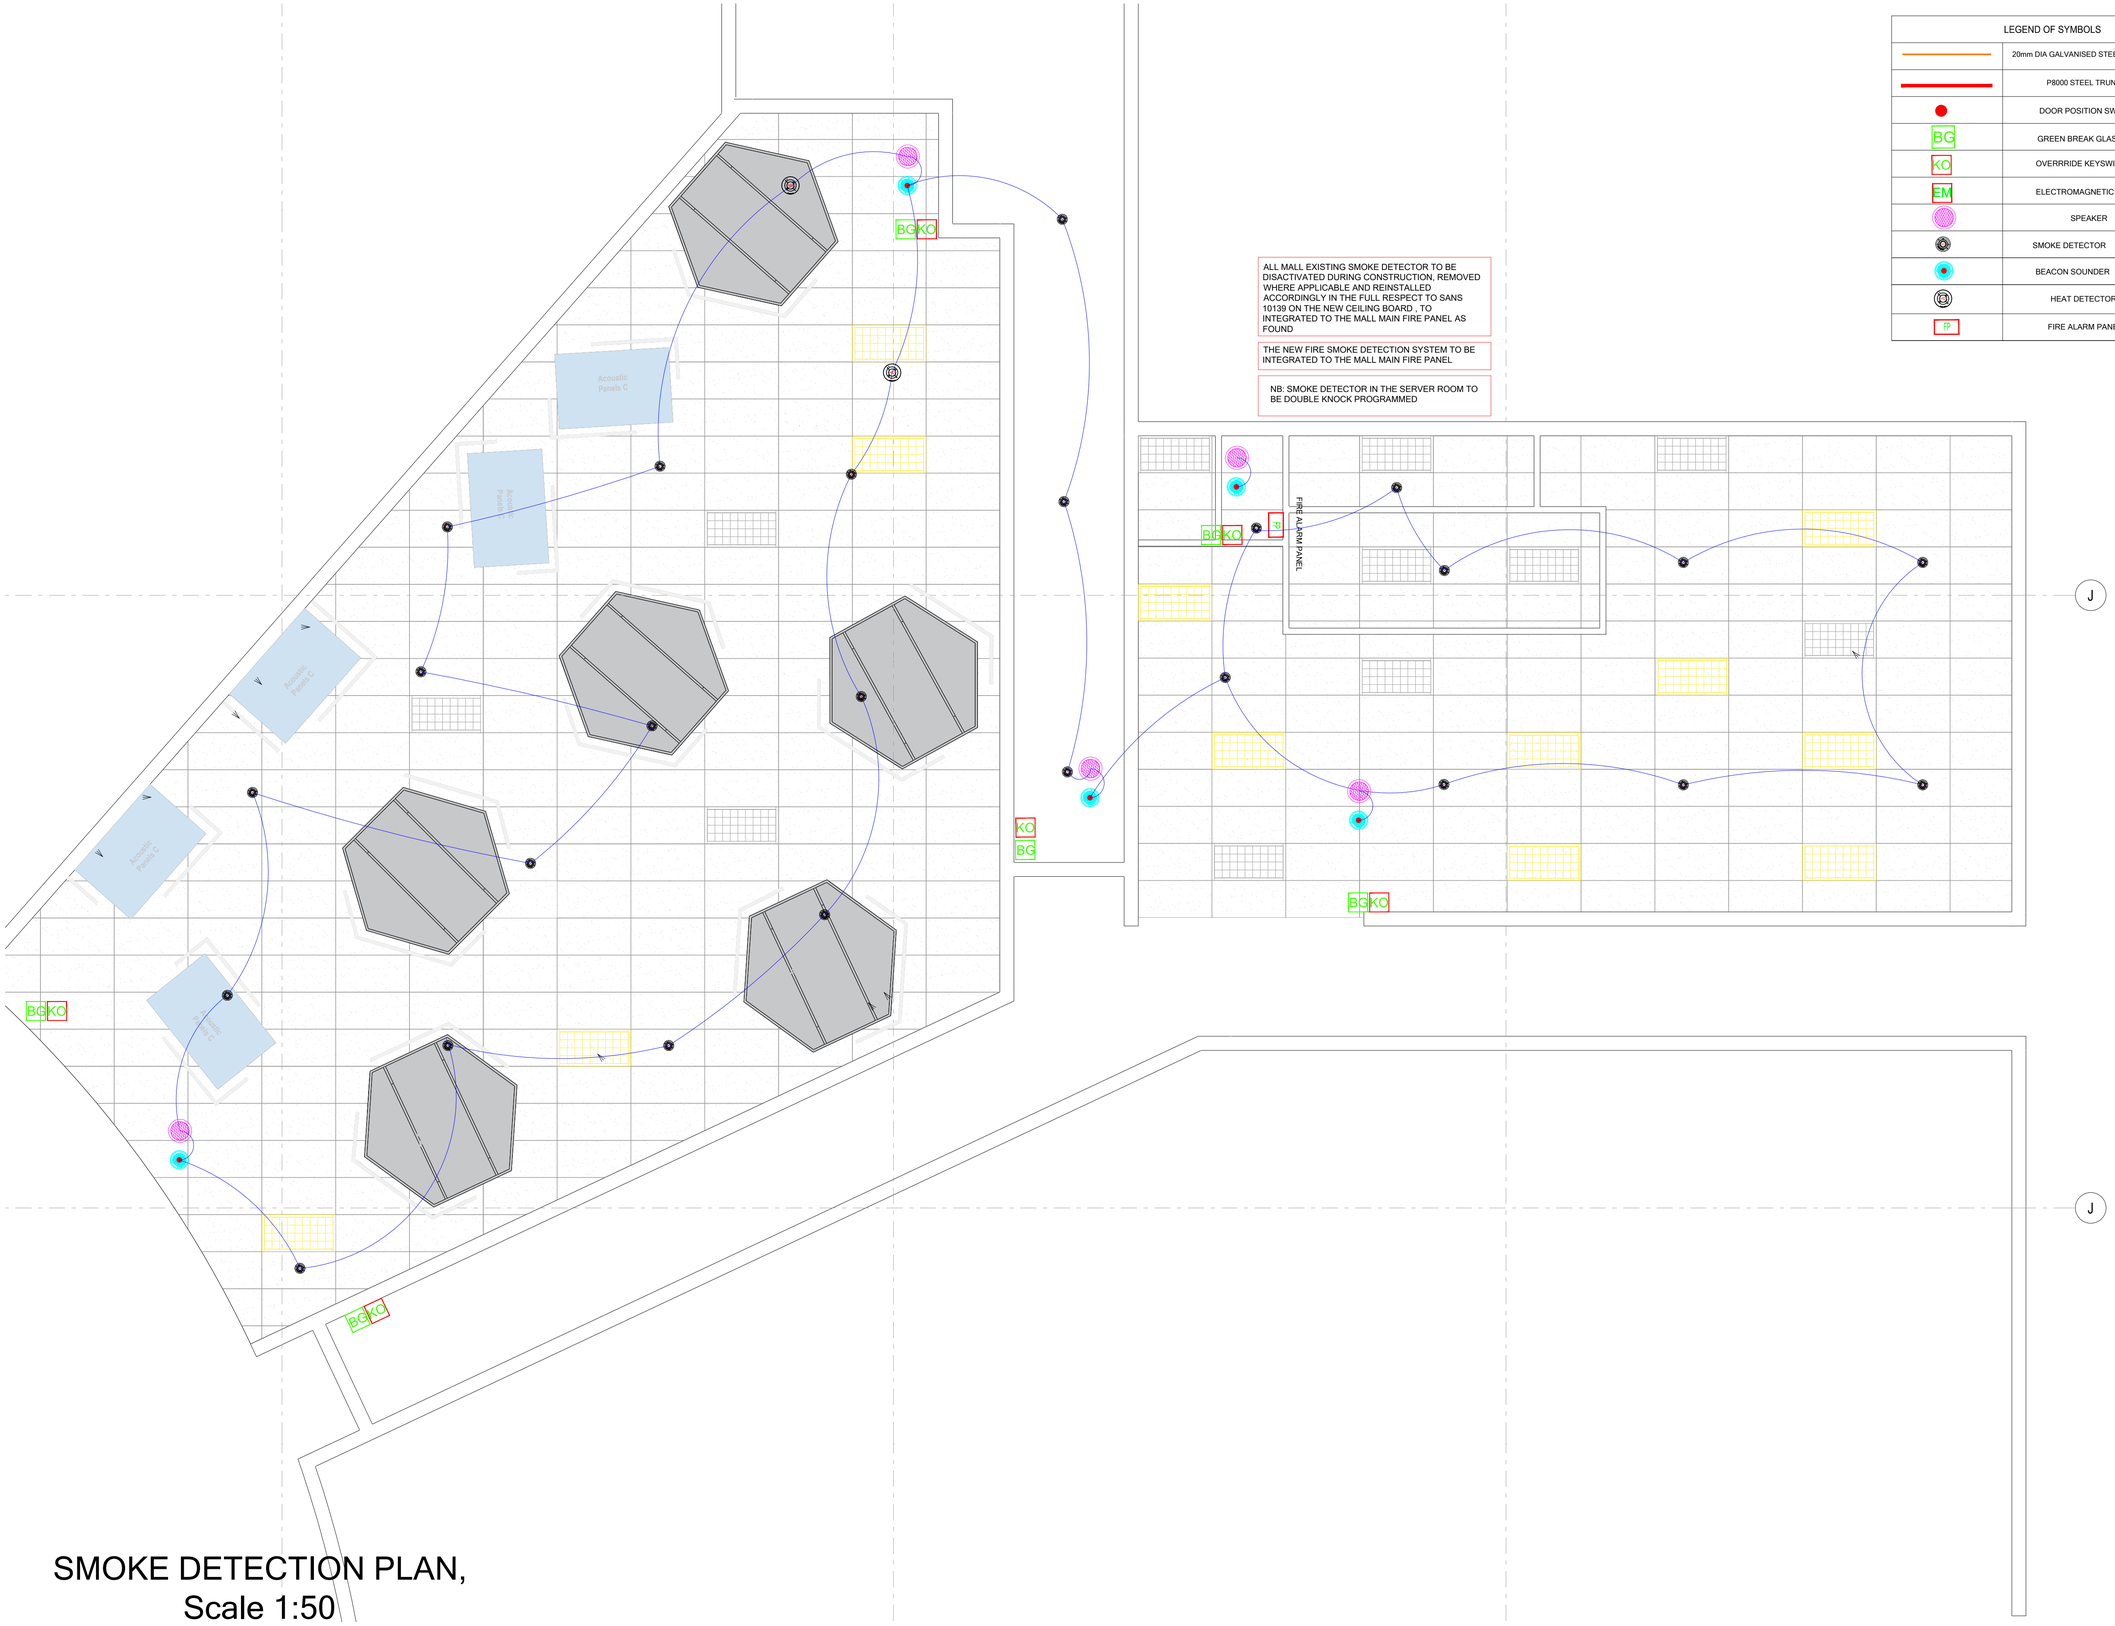

ALL MALL EXISTING SMOKE DETECTOR TO BE DISACTIVATED DURING CONSTRUCTION, REMOVED WHERE APPLICABLE AND REINSTALLED ACCORDINGLY IN THE FULL RESPECT TO SANS 10139 ON THE NEW CEILING BOARD , TO INTEGRATED TO THE MALL MAIN FIRE PANEL AS FOUND

THE NEW FIRE SMOKE DETECTION SYSTEM TO BE INTEGRATED TO THE MALL MAIN FIRE PANEL

NB: SMOKE DETECTOR IN THE SERVER ROOM TO BE DOUBLE KNOCK PROGRAMMED

LEGEND OF SYMBOLS	
	20mm DIA GALVANISED STEEL CONDUIT
	P8000 STEEL TRUNKING
	DOOR POSITION SWITCH
BG	GREEN BREAK GLASS
KO	OVERRRIDE KEYSWITCH
EM	ELECTROMAGNETIC LOCK
	SPEAKER
	SMOKE DETECTOR
	BEACON SOUNDER
	HEAT DETECTOR
FP	FIRE ALARM PANEL

GENERAL NOTES:

- ALL DIMENSIONS AND LEVELS ARE TO BE VERIFIED ON SITE PRIOR TO COMMENCING SETTING OUT WORKSHOP DRAWINGS OR CONSTRUCTION
- FIGURED DIMENSIONS ONLY TO BE USED.
- DISCREPANCIES, ERRORS AND DIMENSIONS ARE TO BE REPORTED TO THE MECHANICAL ENGINEER.(EMPLOYER). IMMEDIATELY THEY BECOME EVIDENT.
- SHOP DRAWINGS TO BE SUBMITTED FOR APPROVAL PRIOR TO MANUFACTURE OR INSTALLATION.

REFERENCE DRAWINGS	
DRAWING NAME/TEKENING NAME	No./Nr.

REVISION/WYSIGINGS		
T	Tender	10-09-2024
Revision Wysiging	Description Beskrywing	Date Datum

Principal Agent:

CELANKOBE
Engineering & Architectural Consultants

Client

Project Infomation

SARS Randfontein

Project Name. / Projek Naam

OFFICE

Services / Tekening Nr.

SMOKE DETECTION PLAN

Drawings No. / Tekening Nr.

FP-003(1-1)

O | A

1:50			
	Designed Ontwerp	T. Nsenga Pr Tech Eng	10-09-2024
	Drawn Geteken	D. N	10-09-2024
	Checked Nagesien	T.Nsenga Pr Tech Eng	10-09-2024

MECHANICAL

APPROVED / DATE

SMOKE DETECTION PLAN,
Scale 1:50