








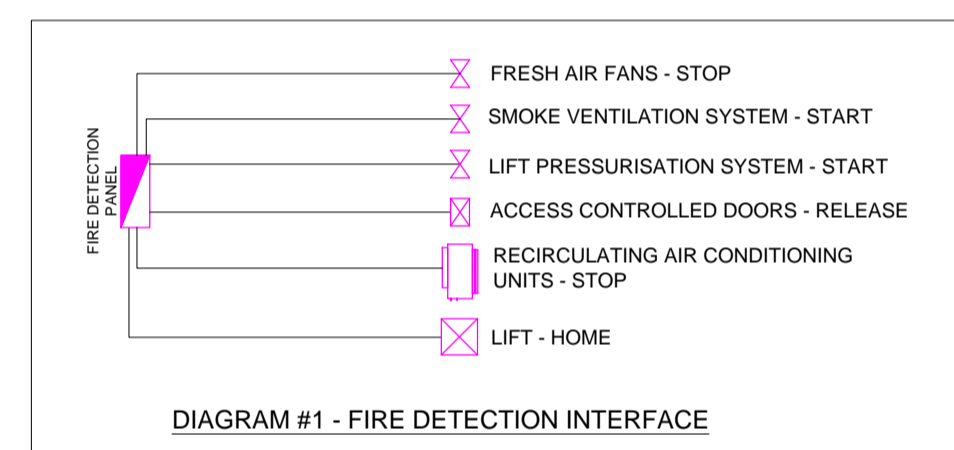
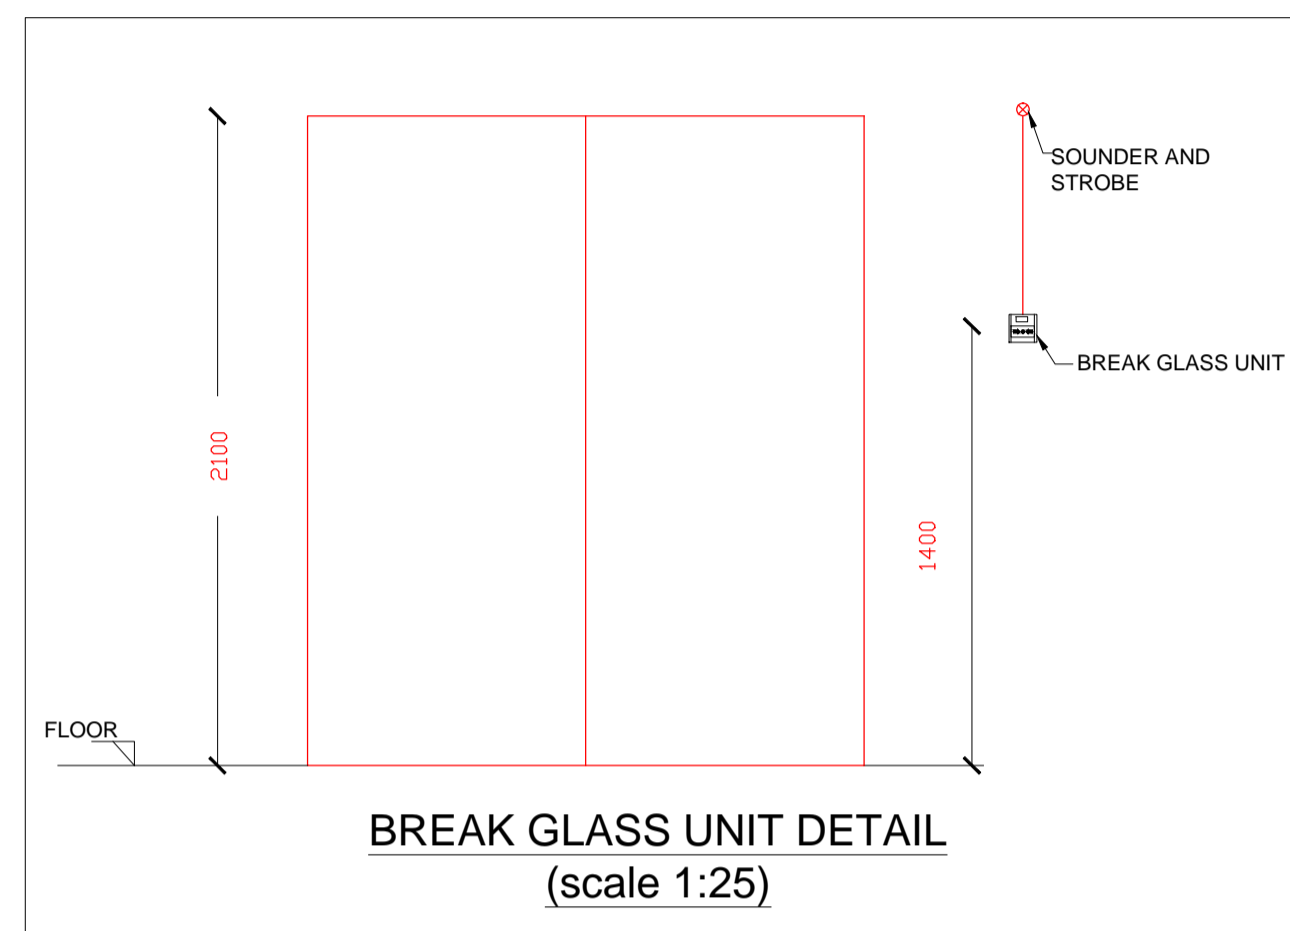


SCOPE OF WORK	
1.	SUPPLY AND INSTALL NEW DETECTION AND EVACUATION EQUIPMENT AS INDICATED. - 40-OFF NEW SMOKE DETECTORS - 2-OFF NEW HEAT DETECTORS - 2-OFF BREAK GLASS UNITS C/W SOUNDER AND STROBE LIGHTS - 4-OFF GREEN BREAK GLASS UNIT - 16-OFF STROBE LIGHTS WITH BUILT IN SOUNDER
2.	COMPLETE A FUNCTIONALITY TEST TO ENSURE THE SYSTEM OPERATES SATISFACTORILY UNDER A FIRE CONDITION.
3.	CONDUCT A SOUND LEVEL TEST FOR THE EVACUATION SYSTEM.
4.	TRAIN OCCUPANTS ON THE SYSTEM INSTALLATION.

FIRE DETECTION LEGENDS & COUNT			
SYMBOL	REFERENCE	DESCRIPTION	QTY.
	BGU	RED BREAK GLASS UNIT WITH SOUNDER AND STROBE	2
	SS	STROBE LIGHT WITH BUILT-IN SOUNDER	16
	SD	SMOKE DETECTOR	40
	DP	FIRE DETECTION PANEL	-
	HD	HEAT DETECTOR	2
	GBGU	GREEN BREAK GLASS UNIT	4
		PH30 FIRE RATED CABLE	960m
		Ø25mm CONDUIT LINK	480m

[illegible]

 CONSULTMECH <i>Mechanical Engineers</i>		09 Plantanus Street Kuilsriver 7580	
		Cell: (072) 948 4470 Tel: (021) 903 1407 Email: info@consultmech.co.za	
PROJECT	LAHAE LA SARS - BLOCK A		
	BROOKLYN		
DWG TITLE	FIRST STOREY - PROPOSED		
	DETECTION LAYOUT		
DWG NUMBER	21B09-D-601-05		REV. A
DESIGNED BY	S. MAFLUYA	SCALE	1:100 @ A1
CHECKED BY	H.D ROUX	ECSA NUMBER	201070151
APPROVED BY	H.D ROUX	ECSA NUMBER	201070151
COPYRIGHT AND RIGHT OF REPRODUCTION OF THIS DRAWING OR ANY PORTION THEREOF IS RESERVED BY THE ENGINEERS			



FIRST STOREY - PROPOSED DETECTION LAYOUT (Scale 1:100)

ISSUE DATE: 2023-08-23		REVISION: A
X	FOR INFORMATION	
	FOR APPROVAL	
	FOR TENDER	
	FOR CONSTRUCTION	
	AS-BUILT	